




PLAN VIEW

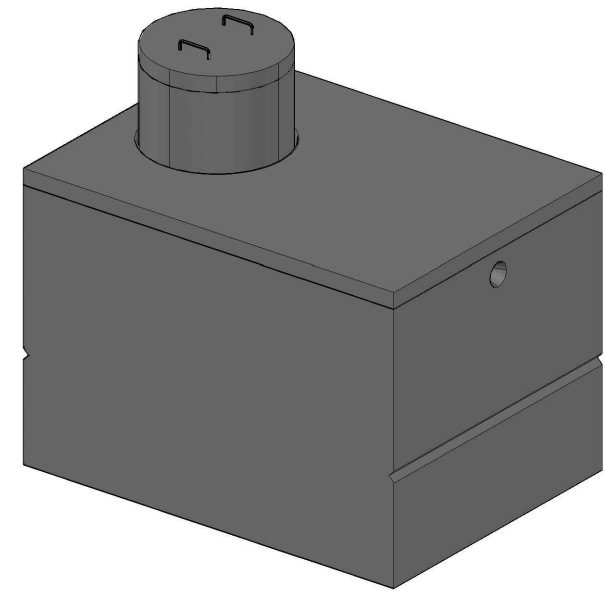


ISOMETRIC VIEW

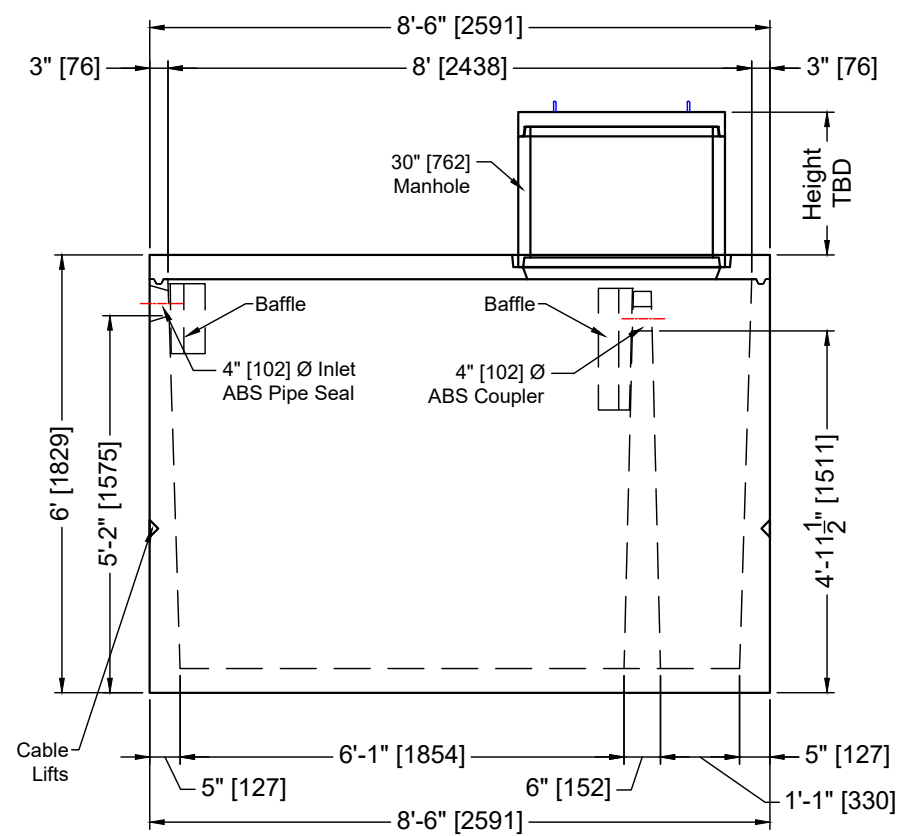


SECTION A-A

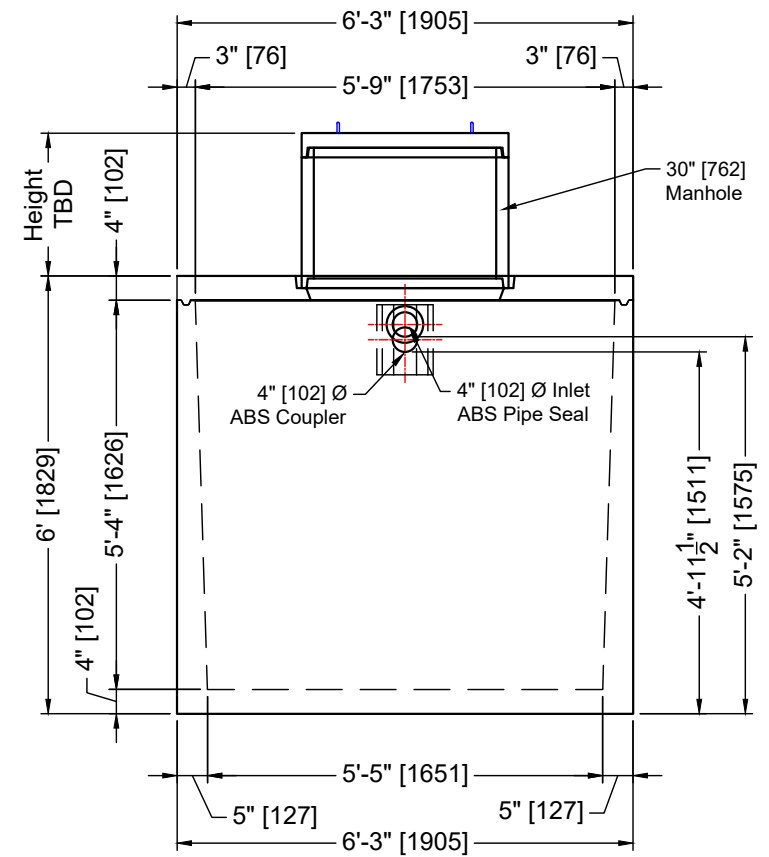


SECTION B-B



BAFFLE DETAIL

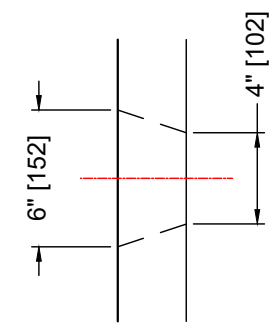


INLET DETAIL

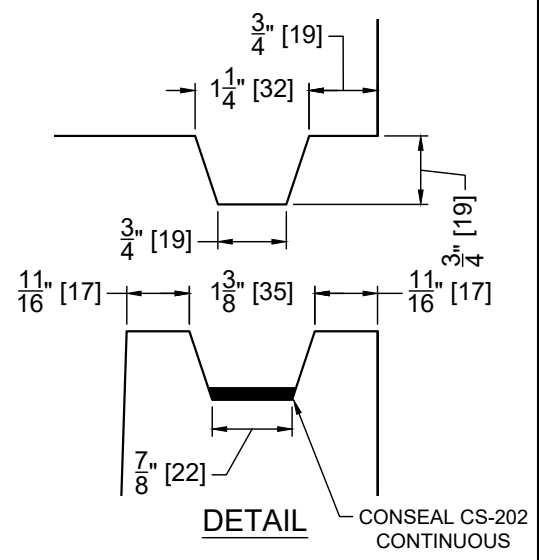

DETAIL CONSEAL CS-202 CONTINUOUS

- NOTES:
- 1) CERTIFIED TO CSA B66-16
 - 2) MAX COVER = 7' (2133mm)
 - 3) CEMENT : PORTLAND CEMENT TYPE 50(HS)
 - 4) Max AGGREGATE SIZE: 20mm
 - 5) 28 DAY STRENGTH: MIN. 35 MPa.
 - 6) ENTRAINED AIR: 6%±1%
 - 7) REINFORCING TO CAN/CSA-G30.18 400 MPa
 - 8) ALL UNITS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.

CONCRETE	RELEASE	MPa	20		
	28 DAY:	MPa	35		
	AIR CONTENT:		6% ± 1%		
	WEIGHT:	kg	6800	VOLUME	m ³
	TYPE:	kg/m ³	2402		



MARK	DESCRIPTION	QTY.



Hwy 39 & Range Road 2150 - PO Box 521
Weyburn, SK S4H 2K3 - NE-25-08-15 W2M
WWW.SVIPRECAST.COM

DWG. NO.	REFERENCE	NO.:	REVISION DESCRIPTION	BY	APP'D	DATE	DRW BY	SWM	2020/11/13
-	-	A	ISSUED PLAN	-	-	2020/11/13	CH'K BY	-	-
-	-	-	-	-	-	-	AP'D BY	-	-
-	-	-	-	-	-	-	AP'D BY	-	-
-	-	-	-	-	-	-	AP'D BY	-	-
-	-	-	-	-	-	-	SCALE: NTS	PAGE: 1 OF 1	

TITLE:	1200 Gallon Septic Tank DETAIL DRAWING	
PROJECT NO.:		JOB NO.:
DRAWING NO.:	SVI-ST-1200-01A	